



\* #5 Bars x 2'-0" Long @ 5'-0" C to C Max @ Mid Depth of Gutter


OUTSIDE SHOULDER TREATMENT

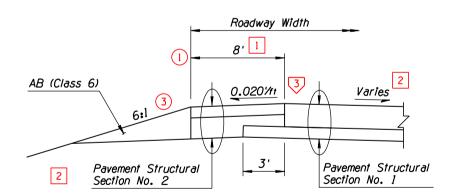


INSIDE SHOULDER TREATMENT 3

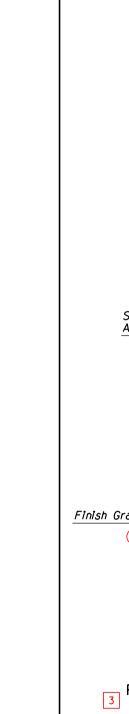

(5)

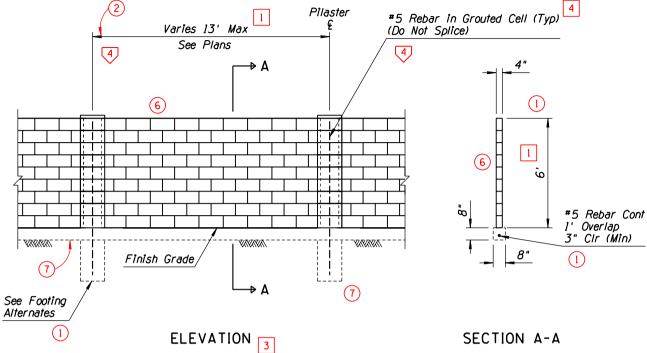

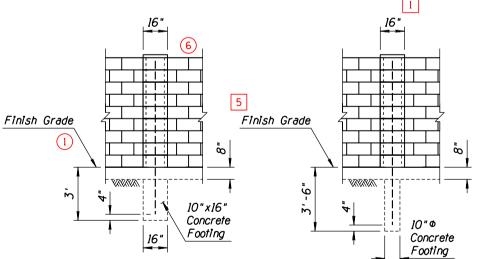

NOTES

Concrete shall be placed against undisturbed soil.

Tongue & Groove Panel Blocks do not require mortared head joints. Mortared head joints shall be required for standard Panel Blocks.

All concrete shall be Class B.
Reinforcing Steel shall be in
accordance with ASTM A-615, Grade 40.

Masonry units shall be in accordance with ASTM C-90, Grade N Type 1  $f'_m = 1,350$  PSI.

Mortar shall be in accordance with ASTM C-270, Type 'S'.

Grout shall be in accordance with ASTM C-476,  $f_c' = 2,000$  PSI.

FOOTING ALTERNATE NO. 1 FOOTING ALTERNATE NO. 2

## ② DETAIL B

PRIVACY WALL FOOTING ALTERNATES

Ū	DESIGN DRAWN CHECKED TEAM LEADER	NAME T MACBETH M HAUER R DELANO J BRUBAKER	DATE 10-90 10-90 12-90	ARIZONA DEPARTMENT OF TRANSPORTATION HIGHWAYS DIVISION HIGHWAY PLANS SERVICES  DETAIL SHEET DETAILS A & B	-				
	SR IOIL	LOCATION	PRICE, FIRST ST - BASELINE				1	OF	10
	•	•							



STD P-04.10